




SITE LIGHTING NOTES

- 1.00 ALL CABLING TO EXTERNAL LIGHTING TO BE 6mm² CU/XLPE/SWA/PVC CONTAINED WITHIN PVC DUCTS.
- 2.00 THE ELECTRICAL CONTRACTOR SHALL, PRIOR TO THE INSTALLATION, VERIFY THE CAPACITY OF THE IN-GROUND DUCT NETWORK TO THE MAIN CONTRACTOR.

SITE LIGHTING REFERENCE KEY

- LIGHTING CIRCUIT
- EX-LC-## ROOT MOUNTED MAST LED LUMINAIRE

EXISTING LIGHTING POLES

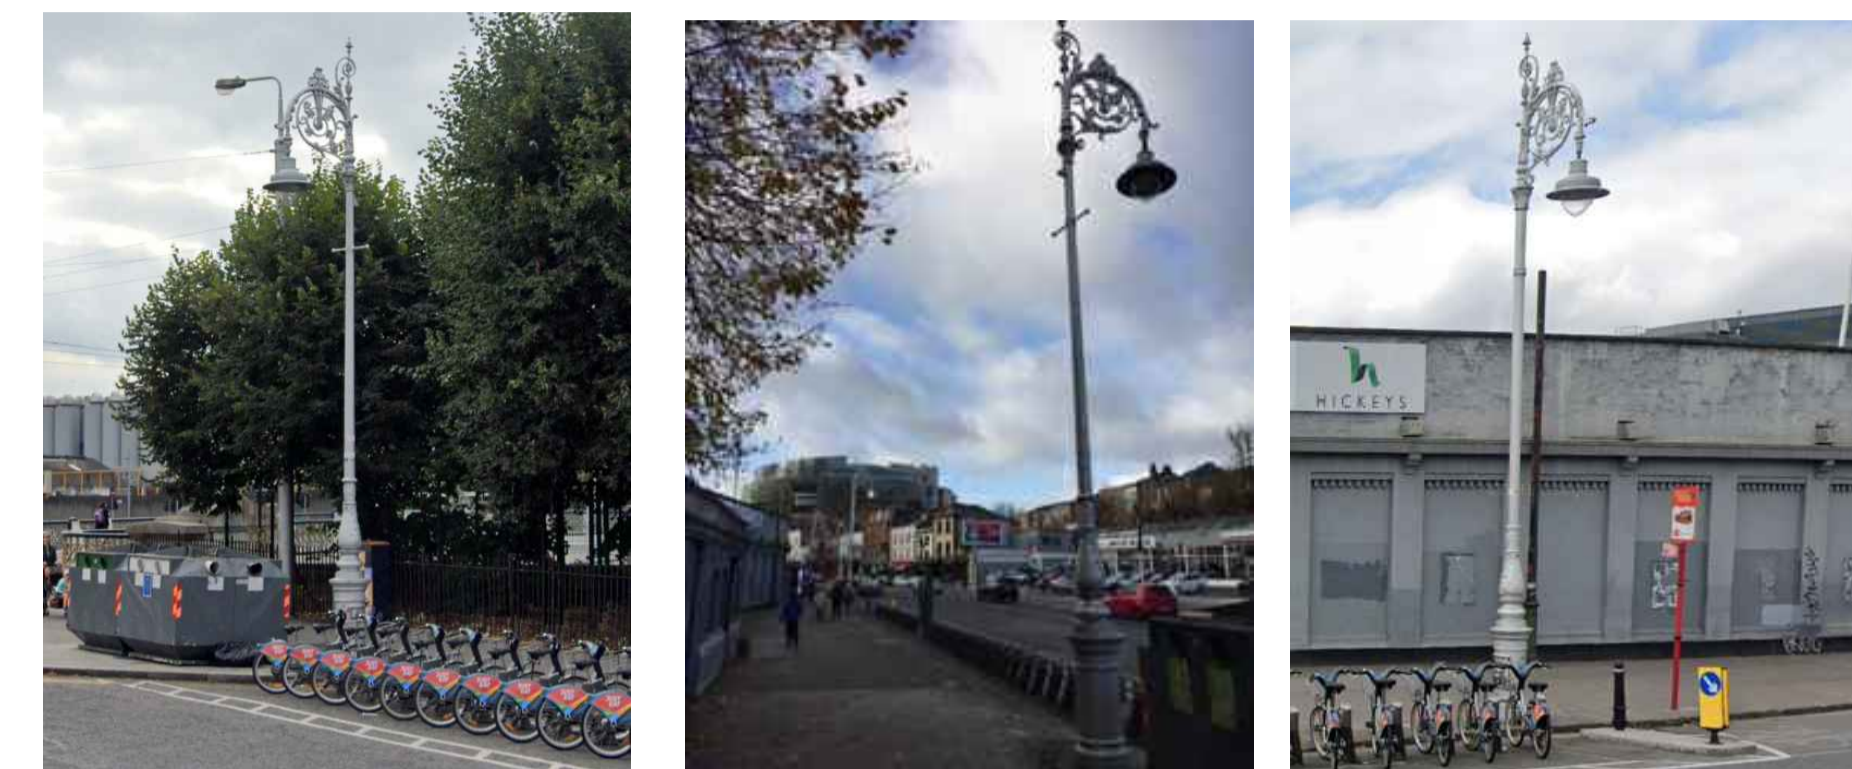

IN2 DUBLIN
 IN2 Engineering Design Partnership
 Unit E&F, Mountpleasant Business Centre,
 Mountpleasant Avenue Upper, D06 P5N8
 t: +353 (0)1 496 0900
 e: info@in2.ie
 w: www.in2.ie

| STATUS | DATE | DESCRIPTION | DRN | ENG | APP | REV |
|--------|------|-------------|-----|-----|-----|-----|
| | | | | | | |

| STATUS | DATE | DESCRIPTION | DRN | ENG | APP | REV |
|--------|------------|----------------|-----|-----|-----|-----|
| P3-S | 25.11.2024 | PLANNING ISSUE | DS | DG | GP | P01 |

PROJECT
 PARKGATE STREET

CLIENT
 RUIRSIDE DEVELOPMENTS LTD

| | | | |
|--|---|-----------------------|------------------------|
| DRAWING TITLE ELECTRICAL SERVICES INSTALLATION SITE PLAN EXTERNAL STREET LIGHTING LAYOUT | | | STATUS P3-S |
| | | | REVISION P01 |
| IN2 REF: D2453 | DRAWING No. PGATE-ZZ-ZZ-ZZZ-DR-IN2-E-0101 | SCALE 1:250 | SIZE A1 |

